



**THE PORT AUTHORITY  
OF NY & NJ**

*Peter K. Sweeney*  
ENGINEERING PROGRAM MANAGER  
WORLD TRADE CENTER  
*Shirley L. Sweeney*  
CHIEF MECHANICAL ENGINEER

Engineering Department  
Design Division

**The World Trade  
Center  
Electrical/HVAC  
Upgrade Program**

Title  
TOWER ONE AND TOWER TWO  
LOW VOLTAGE SUBSTATIONS  
CONSTRUCTION AND  
INSTALLATION

PLUMBING AND SPRINKLER

SUBSTATION SS-75N  
TOWER ONE  
REMOVAL PLANS

No. Date Revision Approved


This drawing subject to conditions in contract.  
All inventions, ideas, designs and methods  
herein are reserved to Port Authority and may not  
be used without its written consent.

W. B. R. L. H. MCD  
Designed by Drawn by Checked by

Date 5/1/95 Scale AS NOTED

Contract Number Drawing Number

**WTC-802.071 PSP-6**

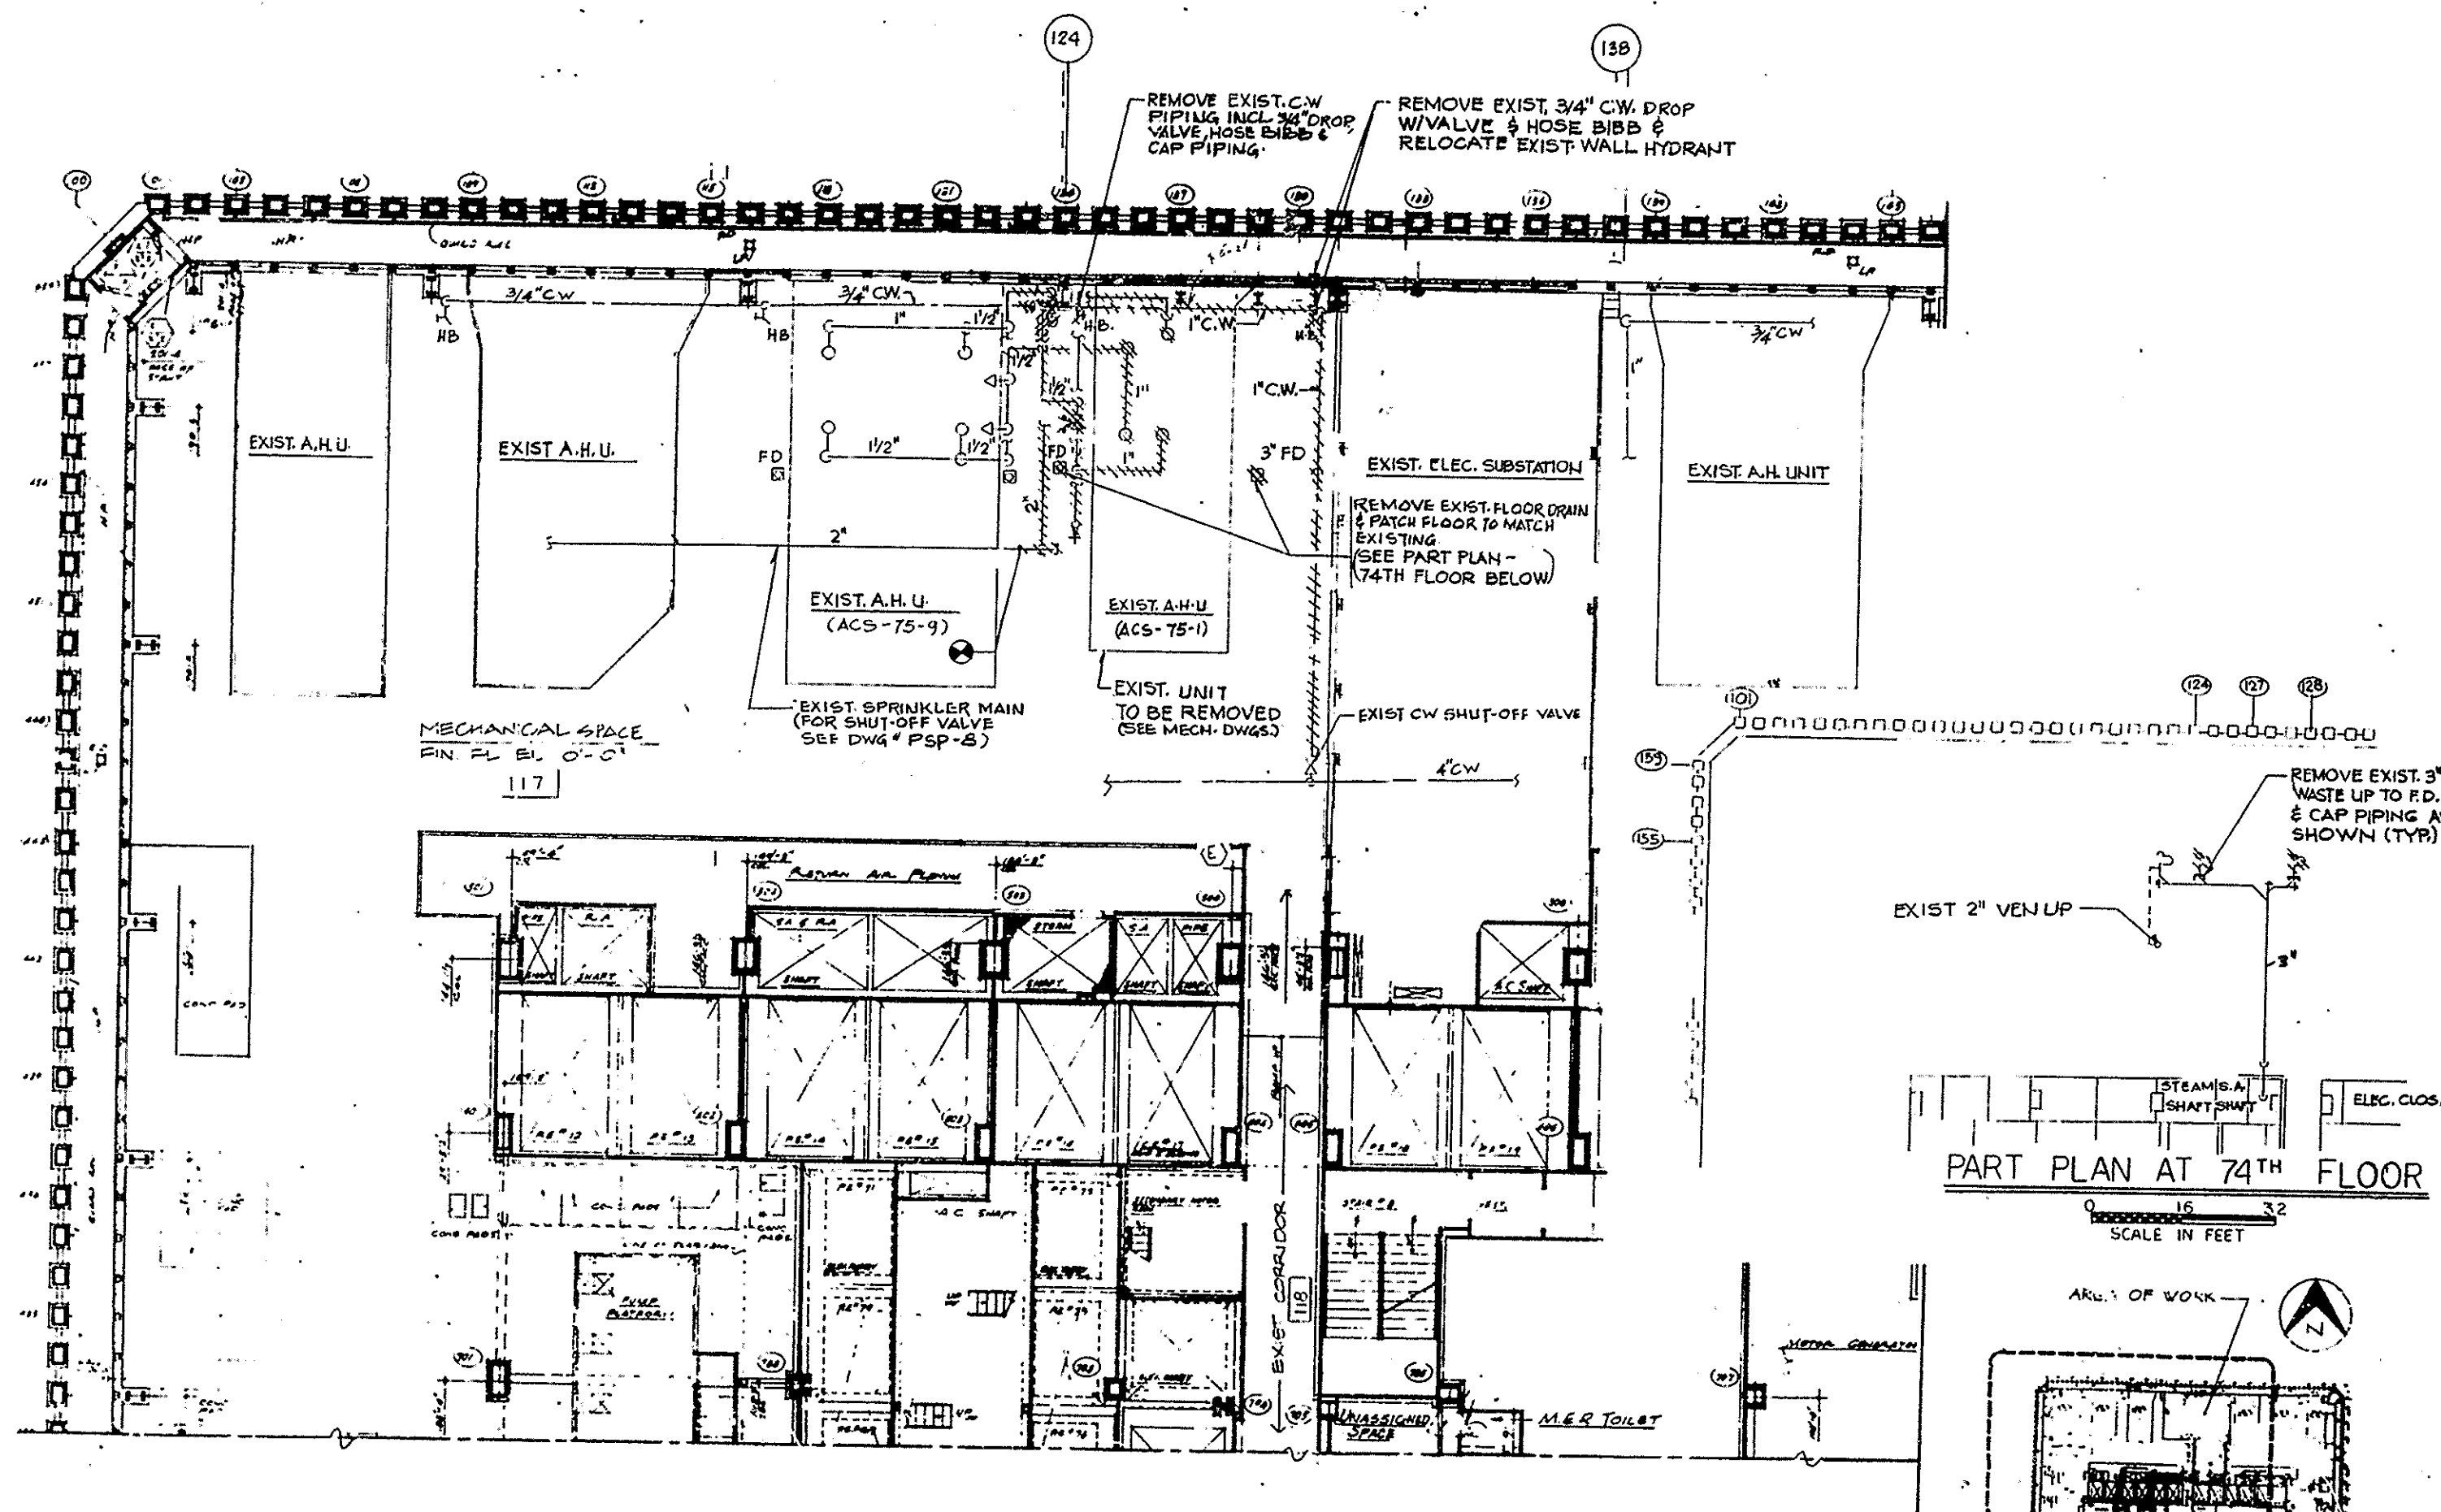

**PART PLAN - 75<sup>TH</sup> FLOOR**

SCALE IN FEET

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT  
COPY OF ONE OF THE CONTRACT DRAWINGS CON-  
STITUTING A PART OF CONTRACT NO. **WTC-802.071**  
IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT  
THE TIME THE SAID CONTRACT WAS EXECUTED BY  
THE PARTIES.

DATE 6/21/95 *Sullivan A. Aslam*  
SPEC. WRITER  
DATE 8/15/95 *Peter K. Sweeney*  
ENGINEER OF DESIGN

**KEY PLAN**  
NO SCALE

